


Caltrans 3/4 Inch Maximum
Class 2 Aggregate Base Test Report
CT 202, CT 217, CT 229, CT 301

Project Name: Byron Crushing & Grinding Services
Project Number: 24-1791
Sample Location: 5595 Byron Hot Springs Rd. Byron, CA
Client Project : --
Project Location : --
Material: 3/4" Class 2 Aggregate Base

Sample Date: 6/15/2026
Test Date: 6/19/2026
Report Date: 6/19/2026
Sampled By: Client
Lab Number: M-3004

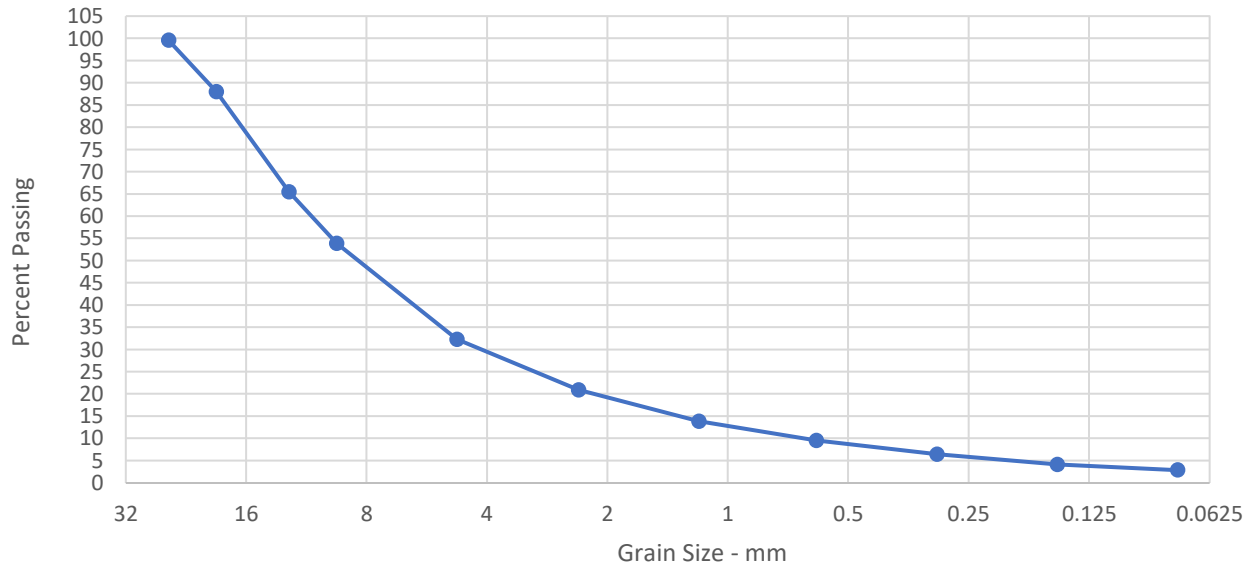

Sieve Size (in.)	Opening (mm)	% Passing	Caltrans Spec.	Pass/ Fail
1	25	100	100	Pass
3/4	19	88	87 - 100	Pass
1/2	12.5	65	--	--
3/8	9.5	54	--	--
#4	4.75	32	30 - 65	Pass
#8	2.36	21	--	--
#16	1.18	14	--	--
#30	0.6	10	5 - 35	Pass
#50	0.3	6	--	--
#100	0.15	4	--	--
#200	0.075	3	0 - 12	Pass

Sand Equivalent	Caltrans Spec.	Pass/Fail
62	22 min.	Pass

Durability Index	Caltrans Spec.	Pass/Fail
40	35 min.	Pass

R-Value	Caltrans Spec.	Pass/Fail
79	78 min.	Pass

***Material tested meets the minimum requirements of Class II Aggregate Base per 2025 Caltrans Standard Specifications, Section 26-1.02B.**



Suzanne Morgan
Laboratory Manager