




# Caltrans Class II Aggregate Base Test Report

CT 202, CT 217, CT 229, CT 301

Project Name: Byron Crushing & Grinding Services  
 Project Number: 22-1484  
 Sample Location: 5595 Byron Hot Springs Rd. Byron, CA  
 Client Project : --  
 Project Location : --  
 Material: 3/4" Recycled AB

Sample Date: 10/28/2022  
 Test Date: 11/1/2022  
 Report Date: 11/3/2022  
 Sampled By: Client  
 Lab Number: M-0209

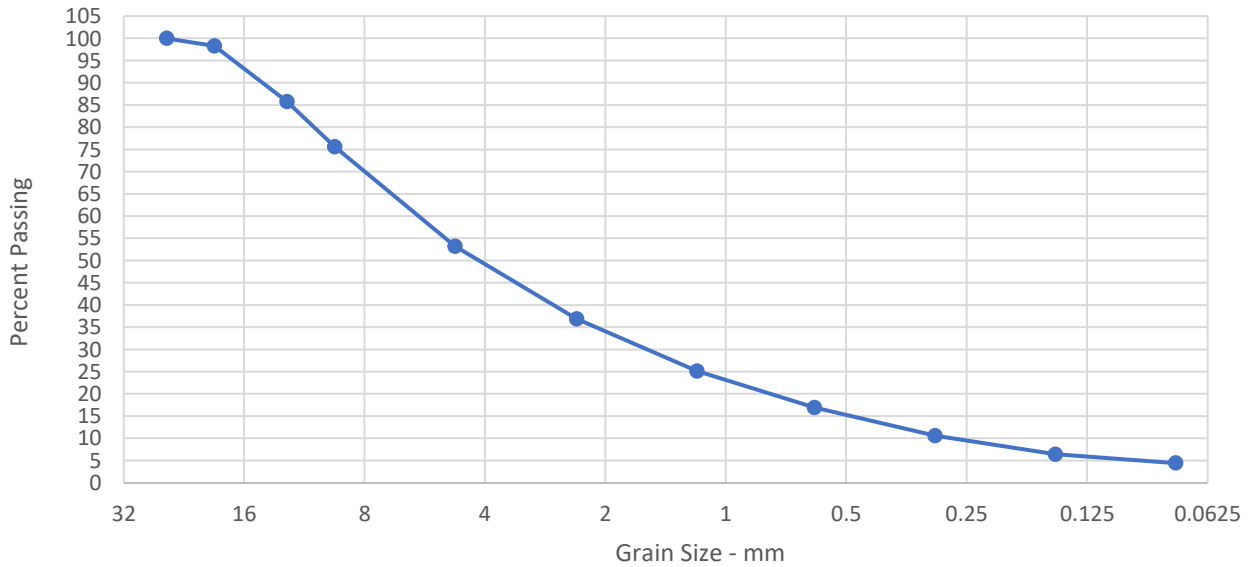

Sieve Size (in.)	Opening (mm)	% Passing	Caltrans Spec.	Pass/ Fail
1	25	100	100	Pass
3/4	19	98	87 - 100	Pass
1/2	12.5	86	--	--
3/8	9.5	76	--	--
#4	4.75	53	30 - 65	Pass
#8	2.36	37	--	--
#16	1.18	25	--	--
#30	0.6	17	5 - 35	Pass
#50	0.3	11	--	--
#100	0.15	6	--	--
#200	0.075	4	0 - 12	Pass

Sand Equivalent	Caltrans Spec.	Pass/Fail
65	22 min.	PASS

Durability Index	Caltrans Spec.	Pass/Fail
41	35 min.	PASS

R-Value	Caltrans Spec.	Pass/Fail
82	78	PASS

**\*Material tested meets the minimum requirements of Class II Aggregate Base per 2018 Caltrans Standard Specifications, Section 26-1.02B.**

Suzanne Morgan  
Laboratory Supervisor