




**Caltrans 3/4 Inch Maximum
Class 2 Aggregate Base Test Report**
CT 202, CT 217, CT 229, CT 301

Project Name: Byron Crushing & Grinding Services
 Project Number: 24-1791
 Sample Location: 5595 Byron Hot Springs Rd. Byron, CA
 Client Project : --
 Project Location : --
 Material: 3/4" Class 2 Aggregate Base

Sample Date: 6/17/2024
 Test Date: 6/19/2024
 Report Date: 6/19/2024
 Sampled By: Client
 Lab Number: M-2350

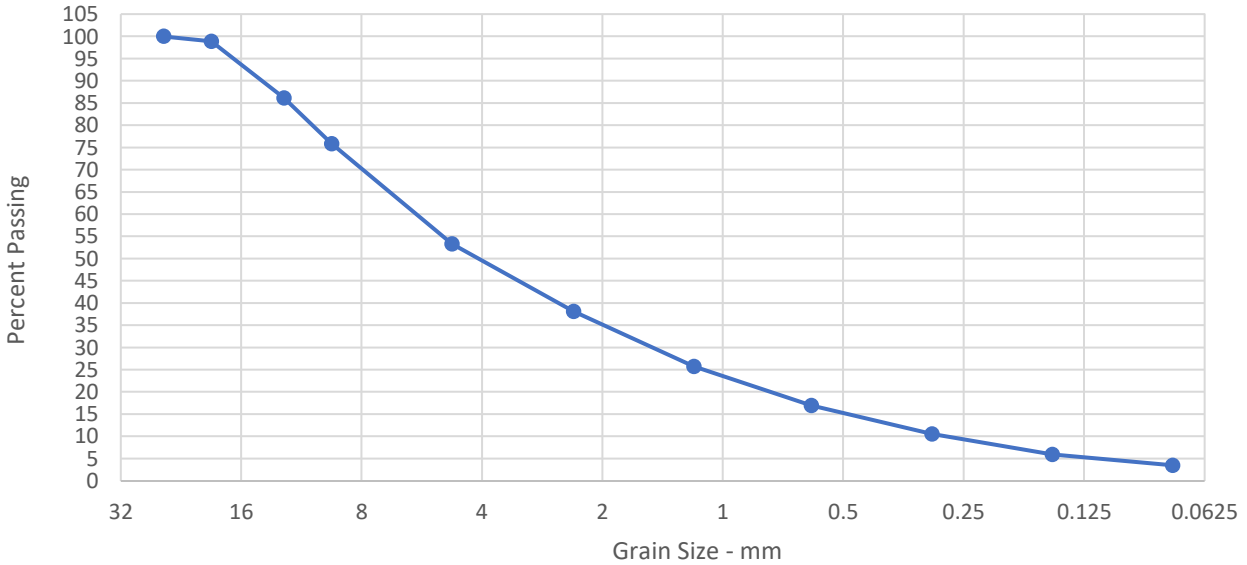

Sieve Size (in.)	Opening (mm)	% Passing	Caltrans Spec.	Pass/ Fail
1	25	100	100	Pass
3/4	19	99	87 - 100	Pass
1/2	12.5	86	--	--
3/8	9.5	76	--	--
#4	4.75	53	30 - 65	Pass
#8	2.36	38	--	--
#16	1.18	26	--	--
#30	0.6	17	5 - 35	Pass
#50	0.3	11	--	--
#100	0.15	6	--	--
#200	0.075	3	0 - 12	Pass

Sand Equivalent	Caltrans Spec.	Pass/Fail
65	22 min.	Pass

Durability Index	Caltrans Spec.	Pass/Fail
36	35 min.	Pass

R-Value	Caltrans Spec.	Pass/Fail
78	78 min.	Pass

***Material tested meets the minimum requirements of Class II Aggregate Base per 2023 Caltrans Standard Specifications, Section 26-1.02B.**

Suzanne Morgan
Laboratory Manager