




Caltrans Class II Aggregate Base Test Report

CT 202, CT 217, CT 229, CT 301

Project Name:	<u>Woodmill Recycling</u>	Sample Date: <u>12/15/2015</u>
Project Number:	<u>15-0095</u>	Test Date: <u>12/16/2015</u>
Sample Location:	<u>Woodmill Recycling</u>	Report Date: <u>12/16/2015</u>
Client Project :	<u>Yard</u>	Sampled By: <u>Client</u>
Project Location :	<u>5595 Byron Hot Springs Rd., Byron, CA</u>	Lab Number: <u>429</u>
Material:	<u>Recycled Aggregate Base</u>	

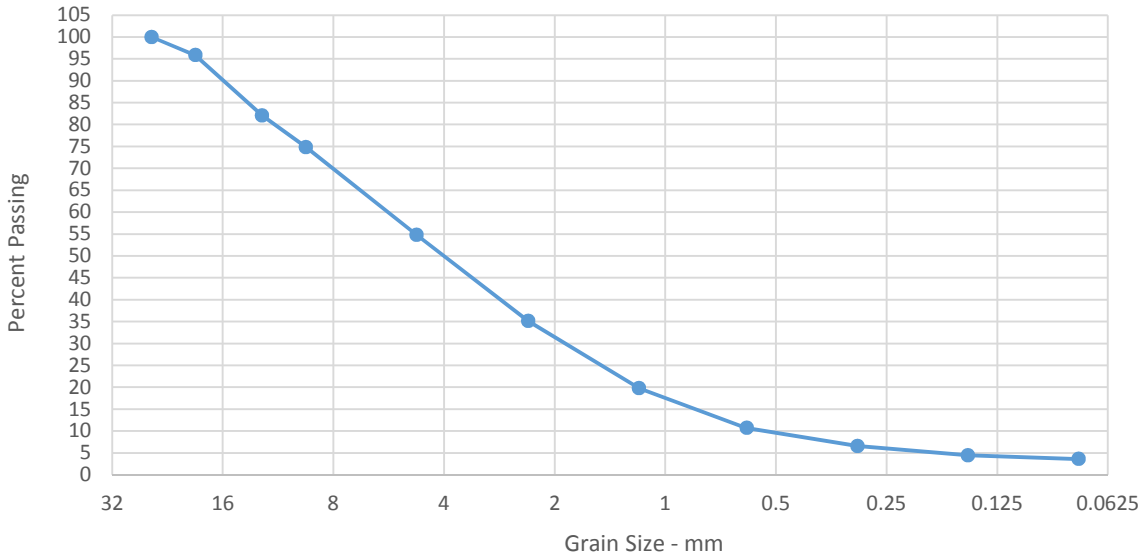

Sieve Size (in.)	Opening (mm)	% Passing	Caltrans Spec.	Pass/ Fail
1	25	100	100	Pass
3/4	19	96	90 - 100	Pass
1/2	12.5	82	--	--
3/8	9.5	75	--	--
#4	4.75	55	35 - 60	Pass
#8	2.36	35	--	--
#16	1.18	20	--	--
#30	0.6	11	10 - 30	Pass
#50	0.3	7	--	--
#100	0.15	4	--	--
#200	0.075	4	2 - 9	Pass

Durability Index	Caltrans Spec.	Pass/Fail
55	35 min.	PASS

R-Value	Caltrans Spec.	Pass/Fail

Trial Number:	1	2	3
Clay Reading:	4.9	5	4.7
Sand Reading:	3.7	4	3.6
Sand Equivalent:	76	78	77
Average SE:	77		
Caltrans Spec.:	25 min.		
Pass/Fail:	PASS		

Benjamin Reeves
Laboratory Supervisor

*Material tested meets the minimum requirements of Class II Aggregate Base per 2010 Caltrans Standard Specifications, Section 26-1.02B.